



2'-6" MIN CENTER TO CENTER FOR MULTIPLE BOX INSTALLATION

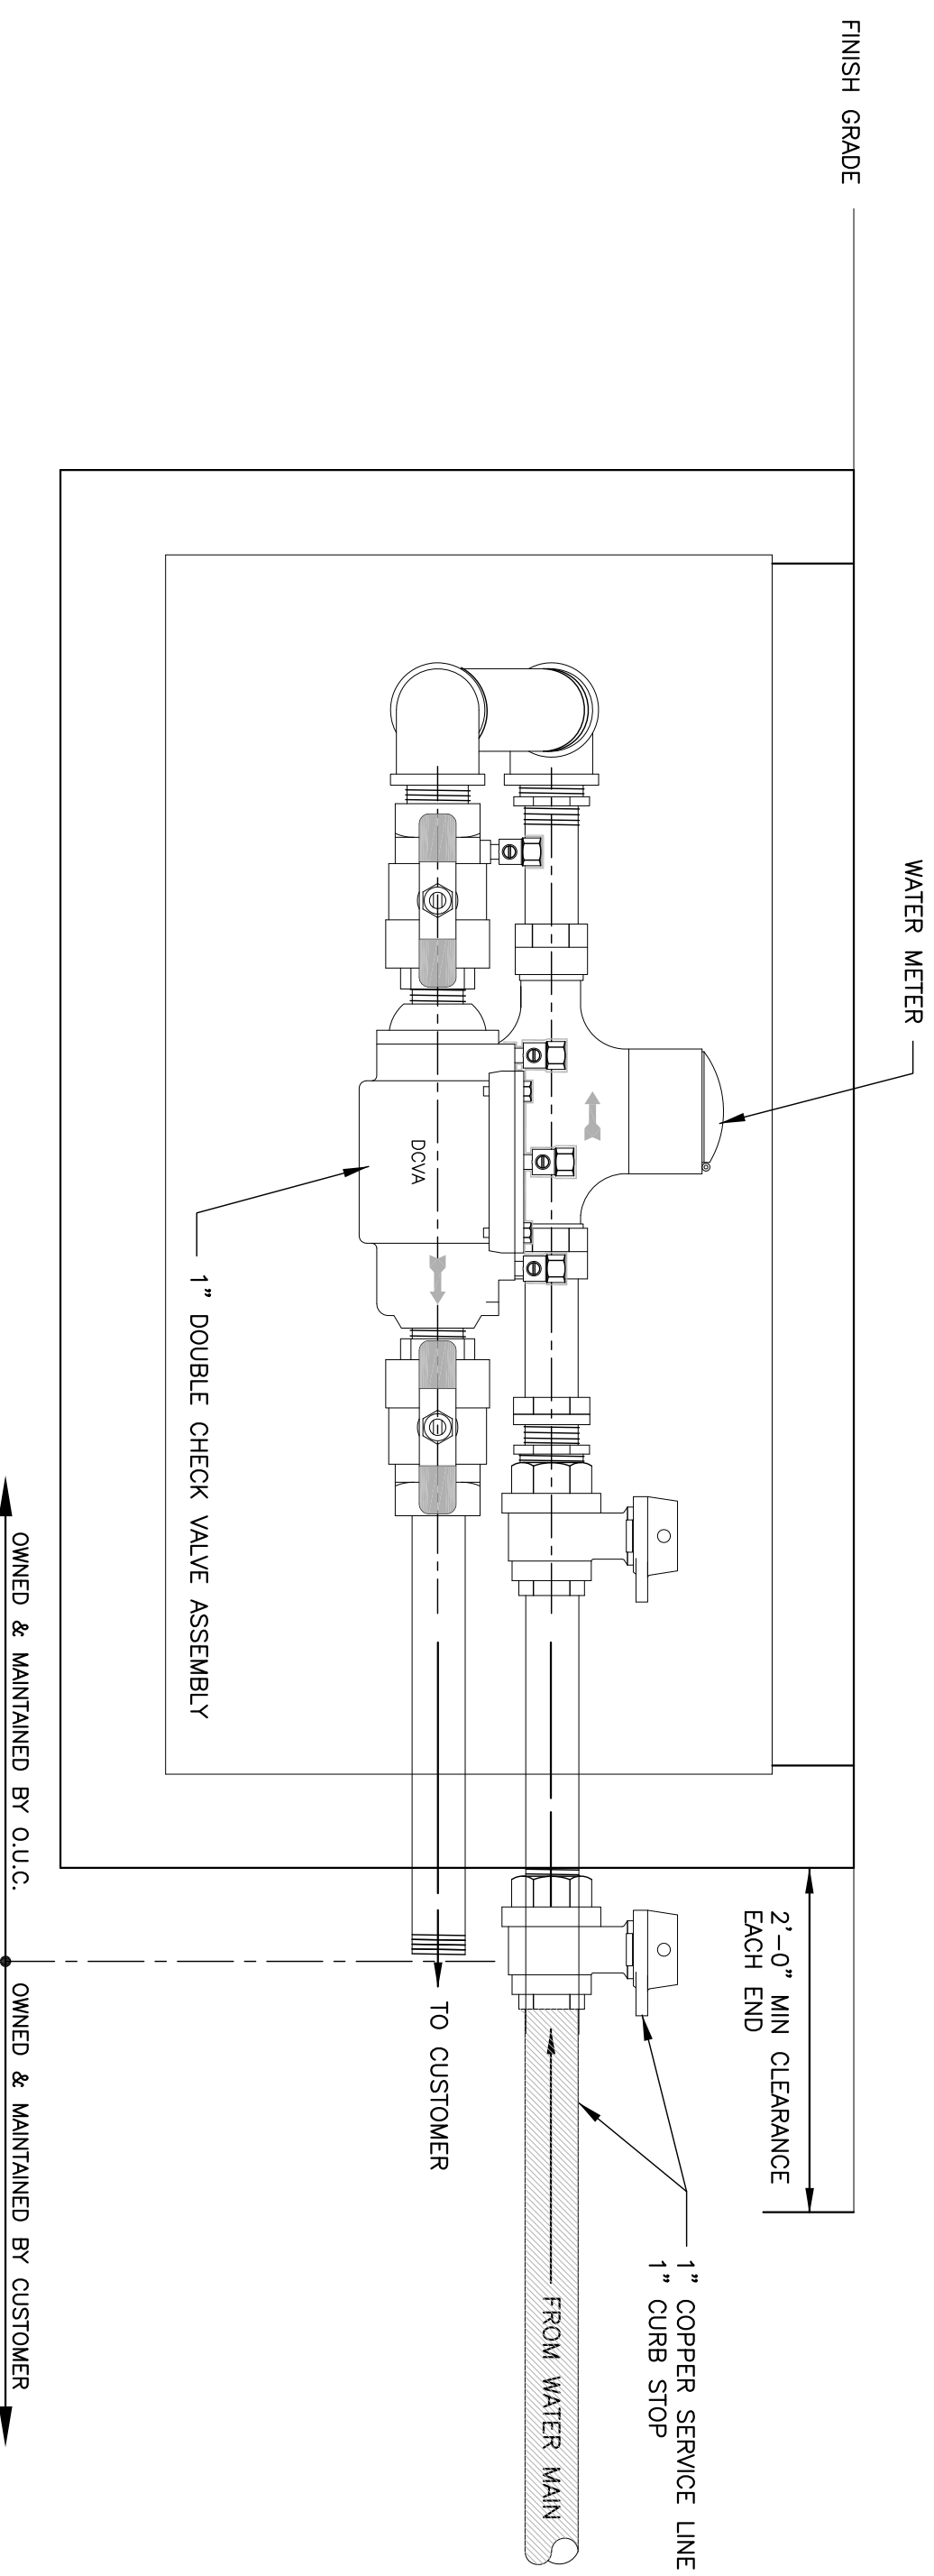

SPECIAL NOTICE:

1. AVAILABLE IN 5/8" AND 1" SIZES ONLY.
2. WHERE RECLAIM WATER IS PROVIDED TO A RESIDENTIAL PROPERTY, O.U.C.'S POTABLE WATER SYSTEM MUST BE PROTECTED BY AN APPROVED DOUBLE CHECK VALVE ASSEMBLY BACKFLOW PREVENTER WITH TOP ACCESS (FOR TESTING AND MAINTENANCE), INSTALLED PARALLEL TO THE OUC POINT OF SERVICE. (SEE DIAGRAM)
NO CONNECTIONS ARE ALLOWED BETWEEN OUC'S METER AND THE BACKFLOW PREVENTER.
3. THE METER AND REQUIRED BACKFLOW PREVENTION DEVICE IS TO BE INSTALLED, OWNED, AND MAINTAINED BY OUC. THE DEVICE MUST BE TESTED ANNUALLY AND AT ALL TIMES MUST REMAIN IN PROPER OPERATION FOR RECLAIM WATER SERVICE TO BE CONTINUED.

		ORLANDO UTILITIES COMMISSION WATER BUSINESS UNIT 3800 GORDONIA AVE., ORLANDO, FL 32839	
ENG. W.E. DRAWN WETS DATE 03-30-09 W.R. NO. N/A ACAD No. N/A SCALE N.T.S.	PROTECTION OF OUC'S POTABLE WATER SYSTEM RESIDENTIAL DOMESTIC METER / BACKFLOW PREVENTER		
FILE RESID-MTR BRP.DWG	MAP SEC. N/A		